



# Kasa Rolniczego Ubezpieczenia Społecznego Oddział Regionalny w Białymstoku

ul. Legionowa 18, 15-099 Białystok  
tel.: 85 749 73 00; fax. 85 749 73 10  
www.krus.gov.pl, e-mail: bialystok@krus.gov.pl

0100-OAG.2300.64.2019

Białystok, dnia 7 czerwca 2019 r.

## Wykonawcy ubiegający się o udzielenie zamówienia

Sprawa: Postępowanie o zamówienie publiczne pn. „Podłączenie do sieci elektrycznej zasilacza UPS EATON 9PX6Ki w serwerowni OR KRUS w Białymstoku

W uproszczonym postępowaniu, do którego na podstawie art. 4 pkt 8 ustawy z dnia 29 stycznia 2004 r. Prawo zamówień publicznych (tj. Dz. U. z 2018 r. poz. 1986) nie stosuje się przepisów ww. ustawy Zamawiający informuje, że:

do podłączenia urządzenia UPS EATON 9PX 6Ki Zamawiający nie wymaga wykorzystania transformatora izolacyjnego (seperacyjnego).

Poniżej wyciąg z instrukcji montażu urządzenia:

### 3. Installation


ENGLISH

#### 3.9 Installation requirements

##### Recommended protective devices and cable cross-sections

##### 1. Recommended upstream protection

UPS power rating	Upstream circuit breaker
5000VA	D curve – 30A
6000VA	D curve – 30A

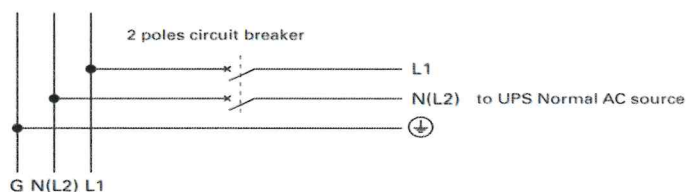

##### 2. Recommended cable cross-sections

Terminal position	Wire function	Terminal wire size rating	Minimum input wire size	Tightening torque
L1	Phase	4-16 mm <sup>2</sup> (12-6 AWG)	6 mm <sup>2</sup> (10 AWG) 105°C	10 lb in / 1.13 Nm
N(L2)	Neutral (Phase)		10 mm <sup>2</sup> (8 AWG) 75°C	
⊕	Ground			

Copper wire, solid or stranded.

p.o. DYREKTORA  
OR KRUS w Białymstoku

mgr Anna Zofia Igratowicz-Grądzka